



TECHNICAL MANUAL

Technical changes and errors reserved

RSK-N wall shoe

Design according to Eurocodes

Version: 19.04.2023*



Index

1.	DE	ESCRIPTION OF THE SYSTEM	3
2.		IMENSIONS AND MATERIALS	
3.		ANUFACTURING	
Э.	IVI	ANOFACIONING	5
;	3.1.	Manufacturing method	5
3	3.2.	Quality control	6
;	3.3.	Markings	6
4.	RE	ESISTANCES	6
5.	US	SER INSTRUCTIONS	8
į	5.1.	Limits of use	8
!	5.2.	Design guidance	9
ļ	5.3.	Reinforcement instructions	10
6.	IN	ISTALLATION	. 16
	5.1.	At the factory	17
(5.2.	Installation of the precast wall element	17
TE	CLINI	ICAL MANUAL PEVISIONS	10



1. DESCRIPTION OF THE SYSTEM

RSK wall shoes are fastening components that are used with RPP- and RPP-E base bolts to create tension resisting connections across joints between two precast wall elements or between precast wall element and a cast-in-situ structure. Compression stresses are transferred directly across the grout filled joint. Shear stresses along the joint are transferred by friction or by additional installed shear studs for this purpose.

Tension stresses developed at the joint are transferred within the wall, via reinforcement, to the next wall joint above and below. The RSK-N wall shoes are designed with matching design tension resistance of the associated RPP base bolts.

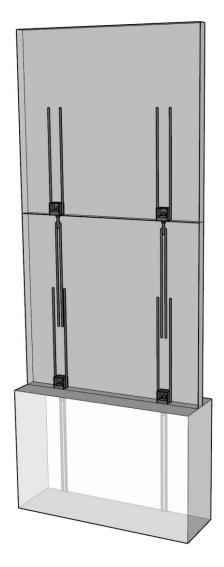


Figure 1. Example of using wall shoes



2. DIMENSIONS AND MATERIALS

Table 1. Materials and standards of RSK-N wall shoe

Part	Material	Standard
Dietes	S355J2	EN 10025
Plates	S355J2+N	EN 10025
Rebars	B500B	EN 10080 (SFS 1268)

Table 2. Dimensions of RSK-N wall shoe

Туре	Size	B [mm]	C [mm]	n [mm]	H [mm]	h [mm]	t [mm]	a _x [mm]	a _y [mm]	c _c [mm]	Weight [kg]
	M16	80	119	2Ø12	630	80	30	76	36	34	4.0
	M20	90	124	2Ø16	800	90	35	80	40	37	6.3
RSK-N	M24	110	129	2Ø20	965	105	35	84	49	45	10.1
	M30	120	144	2Ø25	1170	115	40	90	55	47.5	16.2
	M39	145	165	2Ø32	1600	140	50	99	64	56.5	34.1

Note: n- the number of side bar, \emptyset is diameter of side bar

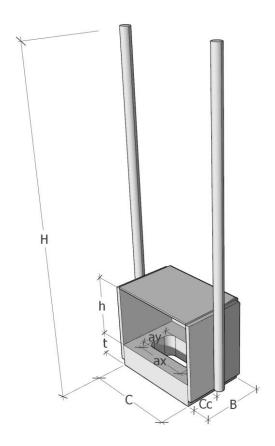


Figure 2. RSK-N type wall shoe



Table 3. Wall shoe non-centric washer dimensions

Туре	Size	e [mm]	c [mm]	D [mm]	t [mm]
	N16	25.0	60	17	12
	N20	27.5	65	21	15
RAL	N24	30.0	80	25	20
	N30	37.5	95	31	20
	N39	47.5	115	40	30

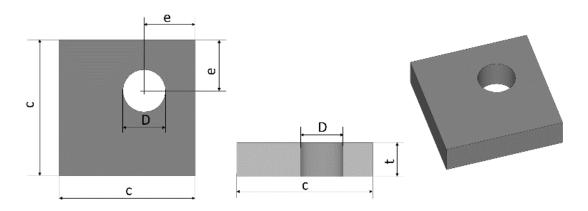


Figure 3. RAL type wall shoe non-centric washer

3. MANUFACTURING

3.1. Manufacturing method

Execution standard: EN 1090-2

Plates: Flame cut, laser/plasma and mechanically cut

Rebars: Mechanically cut

Welding: MAG hand/robot

Welding class: C (EN ISO 5817) in accordance with EXC 2

Surface treatment: Untreated as standard



The product shall be produced clean and dry. Light surface rusting may be present at delivery of the product. The product is to be stored in dry conditions. The product may be installed with light surface rusting, and in accordance with general requirements for reinforcement bars.



3.2. Quality control

Manufacturing and quality control in accordance with SFS-EN 1090-2. R-Group Baltic OÜ internal quality control in accordance with ISO 9001 and ISO 14001. External quality control provided by Inspecta Estonia OÜ.

3.3. Markings

- R-Group Baltic OÜ identifier marking
- Manufacturing date

4. RESISTANCES

The tension capacities of the wall shoes, calculated in accordance with EC (EN 1992, 1993), are governed by the tension capacity of the connected RPP- and RPP-E base bolt. More information is provided in the RSTEEL® RPP- and RPP-E-base bolt technical manual.

Minimum concrete grade of the wall is C25/30.

The anchorage length is determined according to the diameter of the anchor bar.

Anchorage coefficients, lap factor α_6 = 1.5, α_2 = 0.7, others $\alpha_1...\alpha_5$ = 1.0.

Table 4. Nominal RSK-N wall shoe design tension resistances

RSK-N	RAL	RPP base bolt	N _{Rd} [kN]
M16	N16	M16	62.2
M20	N20	M20	97.0
M24	N24	M24	139.4
M30	N30	M30	222.2
M39	N39	M39	386.5



RAL non-centric washers are supplied with RPP base bolts on request. Please see Table 3.



The shear capacity of the shoe is governed by the connected RPP base bolt. The shear strength of the connection can be calculated in accordance with EN 1993-1-8 clause 6.2.2. The additional contribution of friction to shear strength can be taken into account; a friction coefficient of 0.2 can be adopted for a sand-cement grout, without additional tests.

The design shear resistance $F_{v,Rd}$ between a wall shoe base plate and a grout layer are calculated as follows:

$$F_{v,Rd} = F_{f,Rd} + n \cdot F_{vb,Rd}$$

where:

n – the number of anchor bolts in the base plate

 $F_{f,Rd}$ – design friction resistance and calculated as follows:

$$F_{f,Rd} = C_{f,d} \cdot N_{c,Ed}$$

where:

$$C_{f.d} = 0.2$$

 $N_{c,Ed}$ – the design value of the normal compressive force in the wall $\;$

The design shear resistance $F_{vb,Rd}$ of an anchor bolt and should be taken as follows:

$$F_{vb,Rd} = min\{F_{1,vb,Rd}; F_{2,vb,Rd}\}$$

$F_{1,vb,Rd} = \frac{k_1 \cdot a_b \cdot f_{uk} \cdot d_b \cdot t}{\gamma_{M2}}$	$f_{uk} = \text{ultimate strength of the bolt}$ $\text{RPP bolts} \rightarrow f_{uk} = 550 \text{ MPa},$ $d_b = \text{diameter of nominal stress area in thread of anchor bolt}$ $t = \text{thickness of base plate of the wall shoe}$ $\gamma_{M2} = \text{material factor}$ $\text{RPP bolts} \rightarrow \gamma_{M2} = 1.25$
$k_1 = \min \{2.8 \frac{e_2}{D} - 1.7; 2.5\}$	e_2 = edge distance of the bolt center D = hole diameter of non-centric washer (with tolerances)
$a_b = 0.44 - 0.0003 \cdot f_{yd}$	f_{yd} = the yield strength of the anchor bolt, where 235 MPa \leq f_{yd} \leq 640 MPa RPP bolts \rightarrow f_{yd} = 500 MPa
$F_{2,vb,Rd} = \frac{a_b \cdot f_{uk} \cdot A_s}{\gamma_{M2}}$	${\bf A_s}=$ net tensile area of the bolt



Shear force transmission

 $F_{vb,Rd}$ values can be used only if cavity between wall shoe and washer filled with expanding grout, minimum strength corresponding to wall.

If the cavity hasn't filled with expanding grout, shear force can only be transmitted through the anchor bolt if the washer is welded with load bearing weld to the bottom plate of the shoe. In this case $F_{3,vb,Rd}$ values can be used and $F_{f,Rd}$ value will be zero ($F_{f,Rd}=0$).

Shear and tensile capacity of the wall shoes are given Table 5.

Table 5. Tensile and shear capacity of wall shoes

Туре	Size	Size Tensile capacity N _{Rd} [kN]		Shear capacity F _{vb,Rd} [kN]
	M16	62.2	4.6	20.0
	M20	97.0	8.0	31.3
RSK-N	M24	139.4	13.0	44.9
	M30	222.2	23.7	71.6
	M39	386.5	44.3	124.5

R-Steel's R-Design Suite software for wall shoe connections on https://rsteel.fi/ Registration is required.

Wall shoe installation and additional reinforcement must be in accordance with instructions in this user guide.

5. USER INSTRUCTIONS

5.1. Limits of use

The capacities of the wall shoes have been calculated for static loads. Increased load factors are to be adopted for case specific dynamic and fatigue effects. For design in accordance with the Eurocodes, the lowest operating temperature is calculated from EN 1991-1-5.



5.2. Design guidance

Grout is to be applied to the joint as soon as possible after the wall element has been lifted into position. Other structures can be installed on top of the wall element after the grout has hardened. Out-of-plane (transverse) support of the wall element must always be considered carefully.

The RSK-N wall shoe is to be installed in the middle of the precast wall element, and the anchor bars are to be tied to the reinforcement of the wall. Minimum wall thickness and associated minimum concrete cover to the anchor bars of the wall shoe, are given in the table below. Minimum wall thickness is determined considering minimum requirements presented in EN 1992-1-1 for concrete cover to the anchor bars of the wall shoe.

The wall shoe is designed for environmental condition exposure class XC1. Design standard requirements must be carefully considered for other exposure classes, for example minimum wall thickness and concrete cover for fire and exposure classes.

Table 6. Minimum wall thickness and concrete cover

Туре	Size	Wall thickness t _w [mm]	Concrete cover c _c [mm]	Figure
	M16	90	39	1
	M20	90	37	C _c ↓
RSK-N	M24	110	45	t _w
	M30	120	48	c _c
	M39	145	57	

Table 7. Minimum edge distance and spacing

Туре	Size	Edge distance R [mm]	Spacing c/c [mm]	Figure
	M16	140	220	
	M20	150	240	
RSK-N	M24	160	250	
	M30	170	280	
	M39	200	320	← R ← c/c ←



5.3. Reinforcement instructions

Reinforcement of the wall according to EN 1992-1-1 and following details:

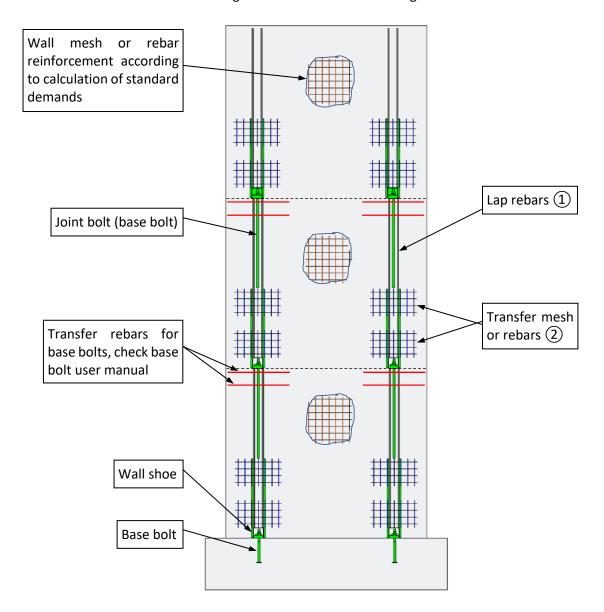


Figure 4. Overview of the reinforced structure

Supplementary transfer reinforcement for the wall shoes must be added according to shoe size. Related values are given in Table 8 to Table 12 based on the shoe type and size. This reinforcement is transverse reinforcement for lapped bars in tension and is applied in the lapping zone between wall shoe sidebars and lapping rebars. Transverse reinforcement is required in the lap zone to resist transverse tension forces and it must be used independently of the main wall reinforcement. Only if the diameter of the lapped bars is less than 20 mm, then any transverse reinforcement or links necessary for other reasons may be assumed sufficient for the transverse tensile forces without further justification according to EN 1992-1-1: 8.7.4.1.



Reinforcement mesh or rebar according to calculation or standard demands.

Minimum mesh requirement on the wall is defined in EN 1992-1-1 section 9.6. Vertical reinforcement should be not less than 0.002Ac. Horizontal reinforcement is 25% of vertical reinforcement or 0.001Ac. Greater value should be used (National Annexes should be checked).

Table 8. Supplementary transfers reinforcement on one side mesh

DCK N	Lapping	Horizonta	al bars 2	а	L _{B1}	L _{A1}	L _{S1}
RSK-N	rebars ①	Øm₁	n	[mm]	[mm]	[mm]	[mm]
M16	2Ø12	Ø6	2	100	200	560	204
M20	2Ø16	Ø6	3	100	300	560	197
M24	2Ø20	Ø8	2	100	200	670	245
M30	2Ø25	Ø8	4	100	400	680	237
M39	2Ø32	Ø10	4	150	600	830	291

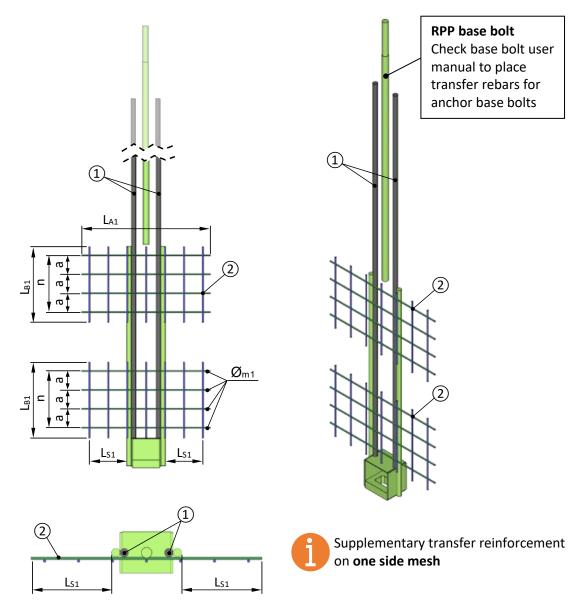


Figure 5. Supplementary transfer reinforcement with one side mesh for RSK-N wall shoe



Table 9. Supplementary transfers reinforcement on one side rebar

DCK N	Lapping	Horizontal bars 2		а	L _{A1}	L _{S1}	
RSK-N	rebars ①	$ \emptyset m_1 $	n	[mm]	[mm]	[mm]	
M16	2Ø12	Ø6	2	100	670	259	
M20	2Ø16	Ø6	3	100	670	252	
M24	2Ø20	Ø8	2	100	870	345	
M30	2Ø25	Ø8	4	100	885	340	
M39	2Ø32	Ø10	4	150	1080	416	

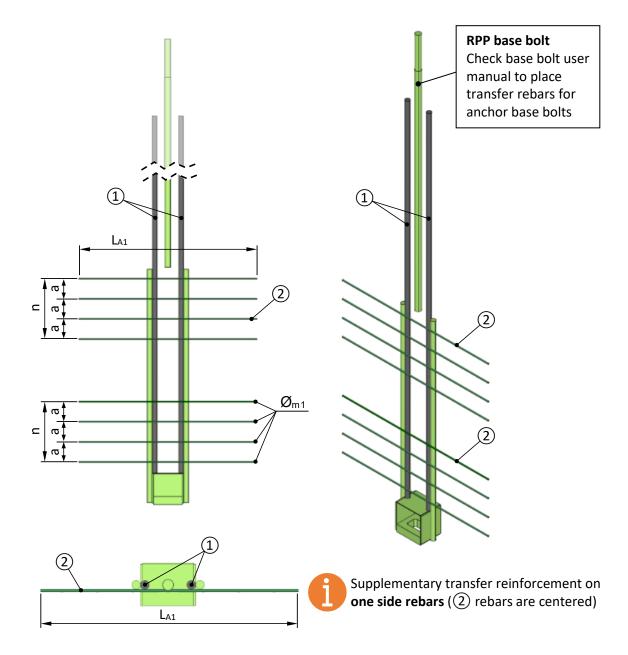


Figure 6. Supplementary transfer reinforcement with one side rebar for RSK-N wall shoe



Table 10. Supplementary transfers reinforcement two sides mesh

DCK N	Lapping	Horizontal bars 2		а	L _{A1}	L _{S1}	
RSK-N	rebars ①	Øm ₂	n	[mm]	[mm]	[mm]	
M16	2Ø12	Ø6	2	100	560	204	
M20	2Ø16	Ø6	2	100	560	197	
M24	2Ø20	Ø6	2	100	670	245	
M30	2Ø25	Ø8	2	150	680	237	
M39	2Ø32	Ø10	2	150	830	291	

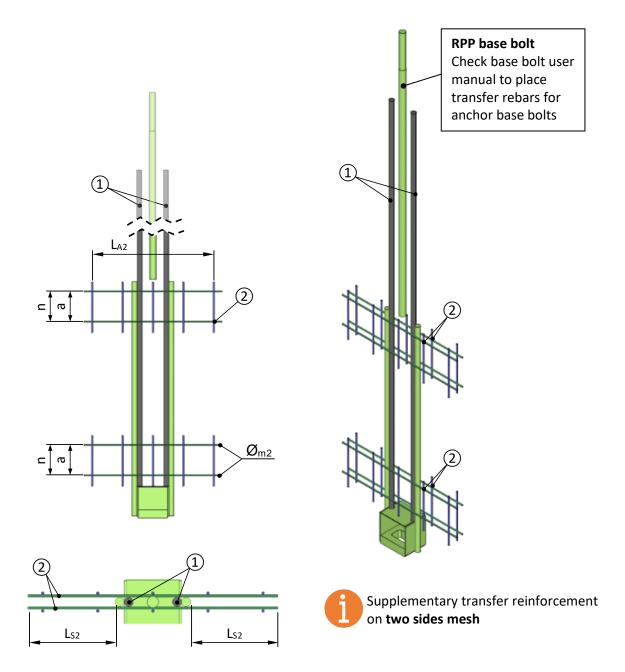


Figure 7. Supplementary transfer reinforcement with two sides mesh for RSK-N wall shoe



Table 11. Supplementary transfers reinforcement two sides rebar

RSK-N	Lapping rebars ①	Horizontal bars 2		а	L _{A2}	L _{S1}
		Øm ₂	n	[mm]	[mm]	[mm]
M16	2Ø12	Ø6	2	100	670	259
M20	2Ø16	Ø6	2	100	670	252
M24	2Ø20	Ø6	2	100	870	345
M30	2Ø25	Ø8	2	150	885	340
M39	2Ø32	Ø10	2	150	1080	416

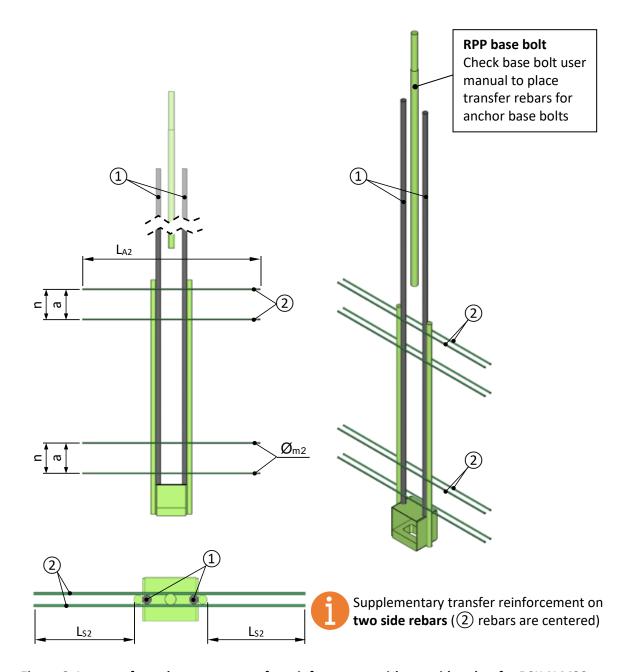


Figure 8. In case of supplementary transfer reinforcement with two side rebar for RSK-N M30



Table 12. Supplementary reinforcement with stirrups

DCK N	Lapping rebars ①	Horizonta	а	
RSK-N		Øms	n	[mm]
M16	4Ø12	Ø8	3	100
M20	4Ø12	Ø8	3	100
M24	4Ø16	Ø8	3	100
M30	4Ø20	Ø8	5	100
M39	4Ø25	Ø10	5	100

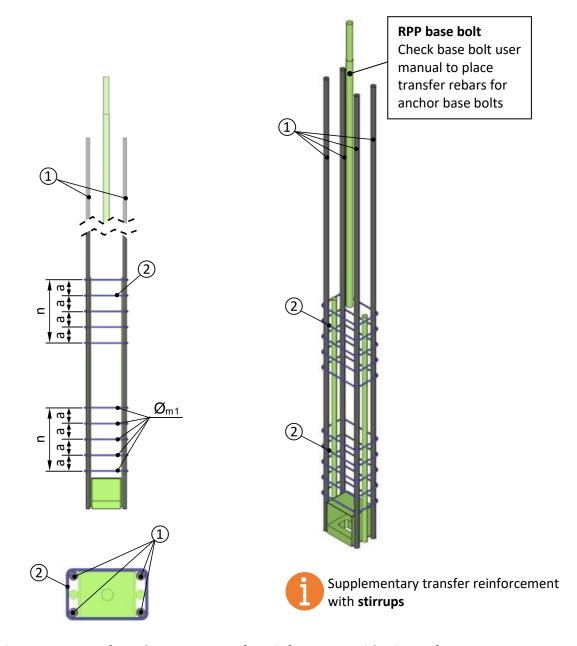


Figure 9. In case of supplementary transfer reinforcement with stirrups for RSK-N M30



6. INSTALLATION

The wall shoe is secured to the reinforcement of the wall, and its base plate is connected, for example, by clamping to the mould. Additional reinforcement is to be installed according to requirements set out in section 5.3. Length of anchor bolt above element joint bottom surface, gap = 20mm.

Table 13. Installation tolerances for RSK-N wall shoe

RSK-N	Transversal direction T _{w,t} [mm]	Longitudinal direction T _{w,l} [mm]		
M16	± 2	± 5		
M20	± 2	± 5		
M24	± 3	± 5		
M30	± 3	± 5		
M39	± 3	± 5		




Figure 10. Installation tolerances for RSK-E wall shoe

Table 14. Installation dimensions and tolerances for RPP base bolts

RPP base bolt	Bolt length h [mm]	Installation tolerance T [mm]		
M16	100	± 3		
M20	110	± 3		
M24	115	± 3		
M30	135	± 3		
M39	160	± 3		



RPP base bolt tolerances are in accordance with their respective technical user manuals.






Figure 11. Installation dimensions and tolerances for RPP base bolts



6.1. At the factory

Checklist before casting:

- The correct shoe type and size is installed
- The positioning of the shoe is correct and according to installation tolerances
- The shoe is properly secured in the reinforcement and mould
- The correct supplementary reinforcement is installed according to manufacturing drawings

Checklist after casting:

- Position of the shoe is correct and according to tolerances
- Shoes are cleaned and any casting boxes are removed

6.2. Installation of the precast wall element

The precast wall element is installed at the correct level by using packer plates. The wall element is to be temporarily supported during erection, and its level and inclination checked. Before the nuts are tightened, the position of the RAL washer plates inside the wall shoe must be checked. Nuts are to be firmly tightened, for example using an impact wrench. Following tightening of the nuts, lifting connections can be disconnected. Erection must follow the erection scheme that is approved by the responsible engineer. Space required for tightening the nut with an impact wrench is verified in accordance with DIN 7444. Once the wall element is set at the correct level and inclination, and the nuts are tightened, the base is to be grouted in accordance with the manufacturer's guidance. The grout must be of a non-shrinking type and with strength greater than the weakest of the concrete structures connected with the bolt and shoe assembly.



NOTES



TECHNICAL MANUAL REVISIONS

08.08.2022 (JK)

■ RSK-N and RSK-E separated to own manuals

31.10.2022 (FA)

New graphical layout

12.04.2023 (FA, AV)

- Supplementary reinforcement graphics and tables visually updated
- Stirrup version is added